


EXTREME ROOF PANEL

3/4" GAP FILLED W/
2-PART EXPANDABLE
FOAM

PANEL SCREWS W/
WASHERS @ 12" O.C.
W/ MINIMUM 1/4"
PENETRATION INTO
STRUCTURAL SUPPORT
(U.N.O.)

3/4"
3/8" 3/8"

ROOF STRAP REQUIRED ON
PITCHES OVER 8/12.
PLACED EVERY 2'-0" O.C. &
FASTENED W/ 10d x 1 1/2"
GALVANIZED NAILS. 10
NAILS PER STRAP IS
REQUIRED.

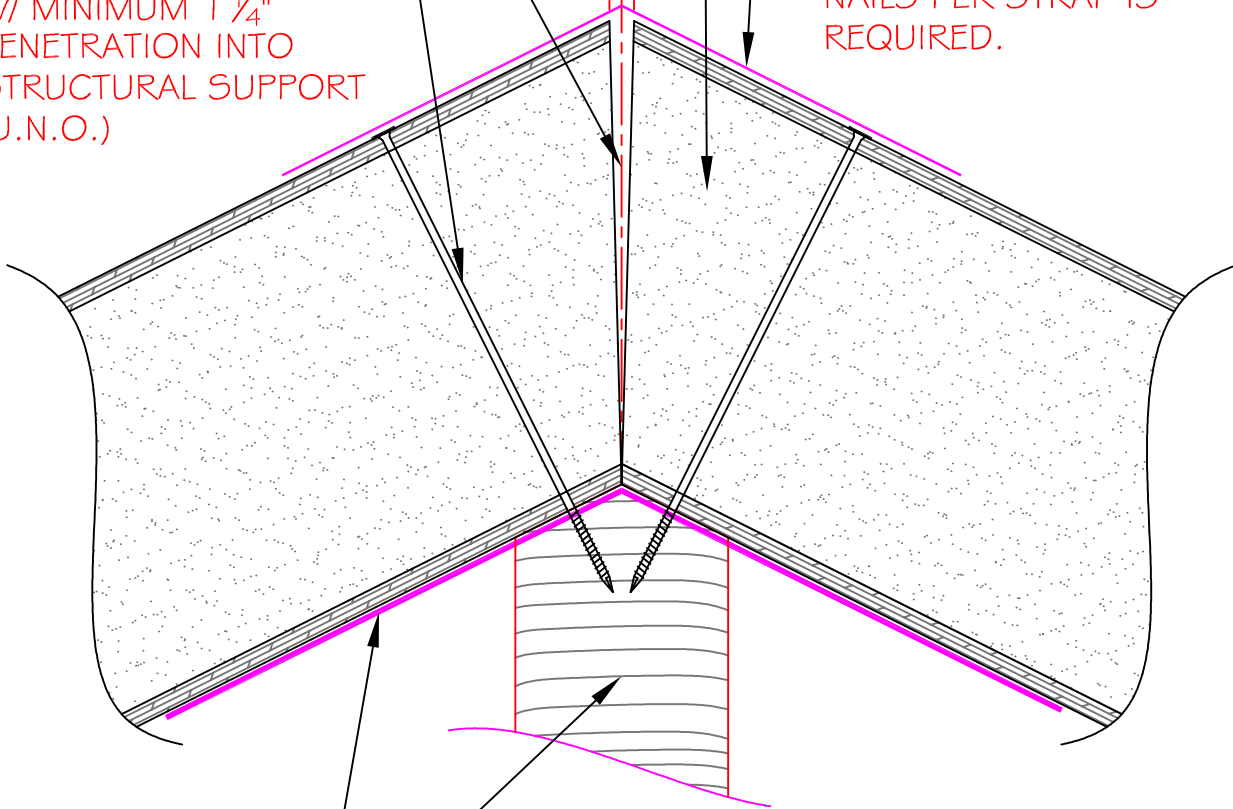

STRUCTURAL SUPPORT MINIMUM 3" WIDE
FOR MINIMUM 1 1/2" BEARING FOR PANEL
ON EACH SIDE

18" SIP TAPE ON (WINTER)
WARM SIDE OF PANEL

SECTION
NOT TO SCALE

DETAIL TITLE : FLUSH FOAM RIDGE (STANDARD)

DETAIL NO. : EP-405

PAGE NO. : 4 - 5

UPDATED : MARCH 2017

Extreme Panel

TECHNOLOGIES, INC.

STRUCTURAL INSULATED PANELS