


2x LUMBER IN END
OF ROOF PANEL

PANEL SCREWS W/
WASHERS @ 24" O.C.
W/ MINIMUM 1 1/4"
PENETRATION INTO 2x
LUMBER (U.N.O.)

PANEL SCREWS
W/ WASHERS @
12" O.C. W/
MINIMUM 1 1/4"
PENETRATION
INTO
STRUCTURAL
SUPPORT
(U.N.O.)

1 1/2" SCREWS @ 8" O.C.
OR 2"-8d NAILS @ 6" O.C.
FASTENED EACH SIDE

CONTINUOUS 3/8" # 1/2"
PANEL SEALANT
TYPICAL EACH SIDE

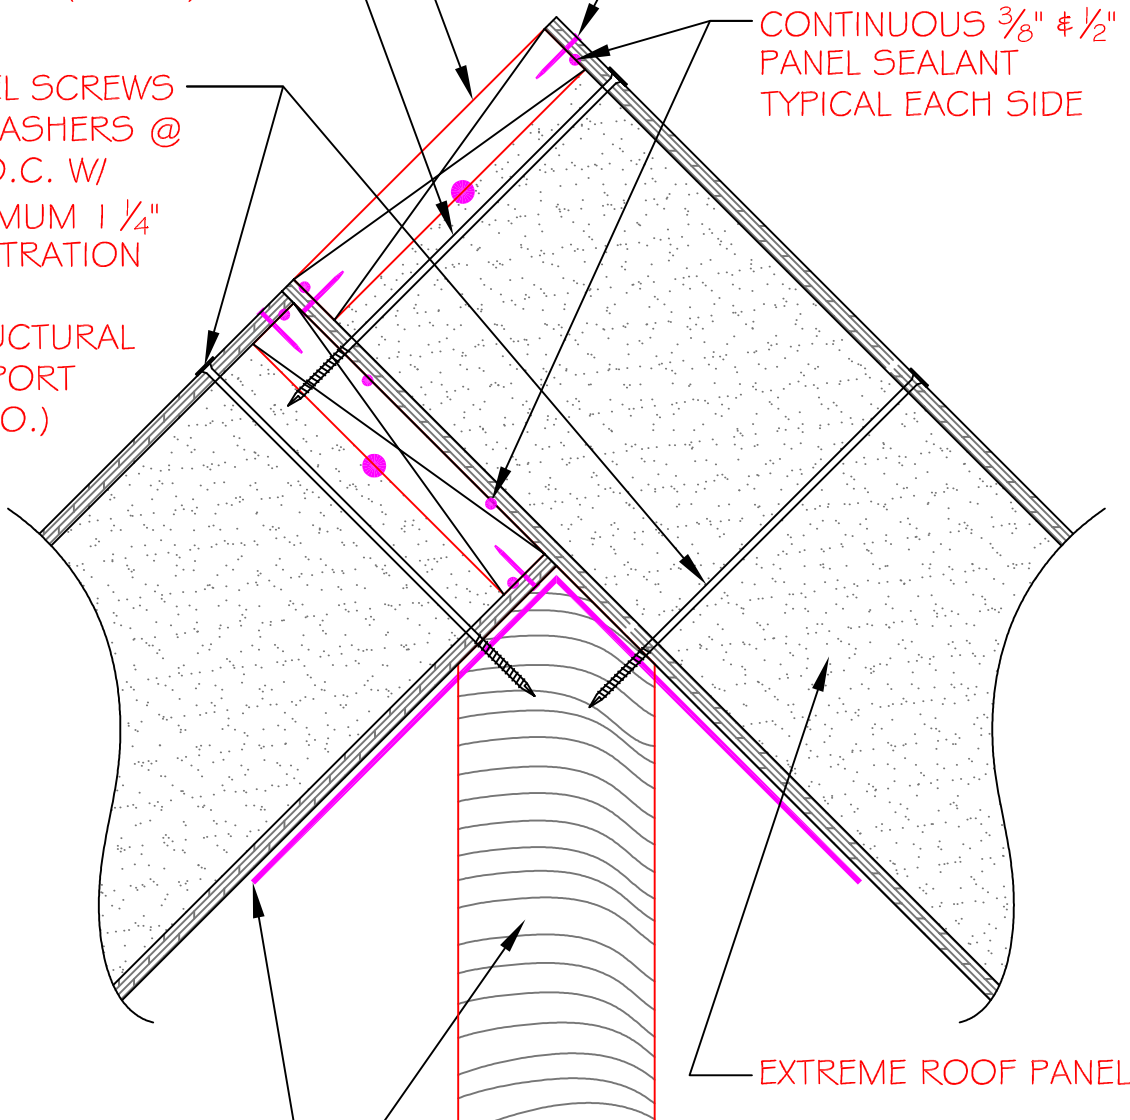

EXTREME ROOF PANEL

STRUCTURAL SUPPORT MINIMUM 3" WIDE
FOR MINIMUM 1 1/2" BEARING FOR PANEL
ON EACH SIDE

18" SIP TAPE ON (WINTER)
WARM SIDE OF PANEL

SECTION
NOT TO SCALE

DETAIL TITLE : 12:12 PITCH RIDGE

DETAIL NO. : EP-407

PAGE NO. : 4 - 7

UPDATED : MARCH 2017

Extreme Panel

TECHNOLOGIES, INC.

STRUCTURAL INSULATED PANELS