


CONTINUOUS $\frac{3}{8}$ " # $\frac{1}{2}$ "
PANEL SEALANT TYPICAL
EACH SIDE AND BOTH
FACES

PANEL SCREWS W/
WASHERS @ 12" O.C.
W/ MINIMUM $\frac{1}{4}$ "
PENETRATION INTO
STRUCTURAL SUPPORT
(U.N.O.)

$\frac{1}{2}$ " SCREWS @ 8" O.C.
OR 2"-8d NAILS @ 6"
O.C. TOP AND BOTTOM
OF PANEL (U.N.O.)

EXTREME ROOF PANEL

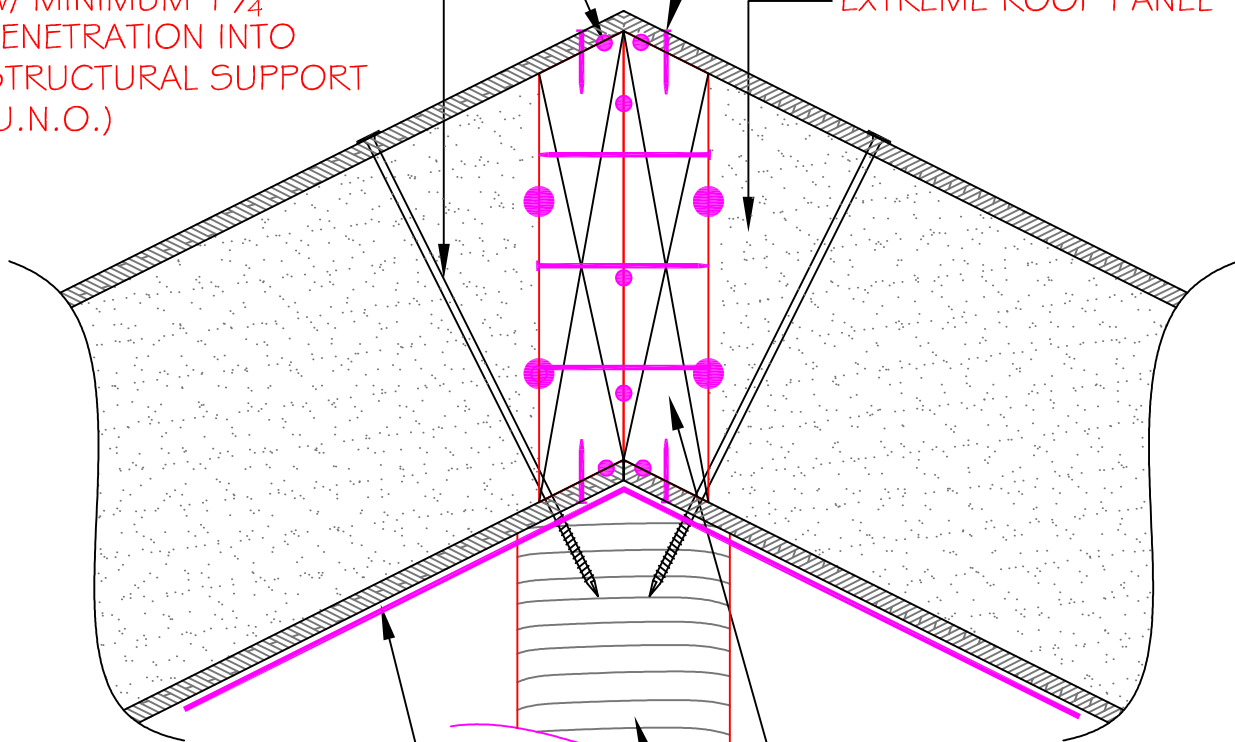

1 8" SIP TAPE ON (WINTER)
WARM SIDE OF PANEL

STRUCTURAL SUPPORT MINIMUM 3" WIDE
FOR MINIMUM $\frac{1}{2}$ " BEARING FOR PANEL
ON EACH SIDE

DOUBLE BEVELED 2x OR
LVL SPLINE W/ 3" CONST.
LAGS 24" O.C. OR 16d
NAILS @ 12" O.C. IN 3
ROWS STAGGERED W/
PANEL SEALANT BETWEEN
MEMBERS (U.N.O.)

SECTION
NOT TO SCALE

DETAIL TITLE : ROOF HIP (LUMBER CONNECTION)

DETAIL NO. : EP-413

PAGE NO. : 4 - 13

UPDATED : MARCH 2017

Extreme Panel

TECHNOLOGIES, INC.

STRUCTURAL INSULATED PANELS